



4415

4415


4415

4415

Transformer

Pullbox



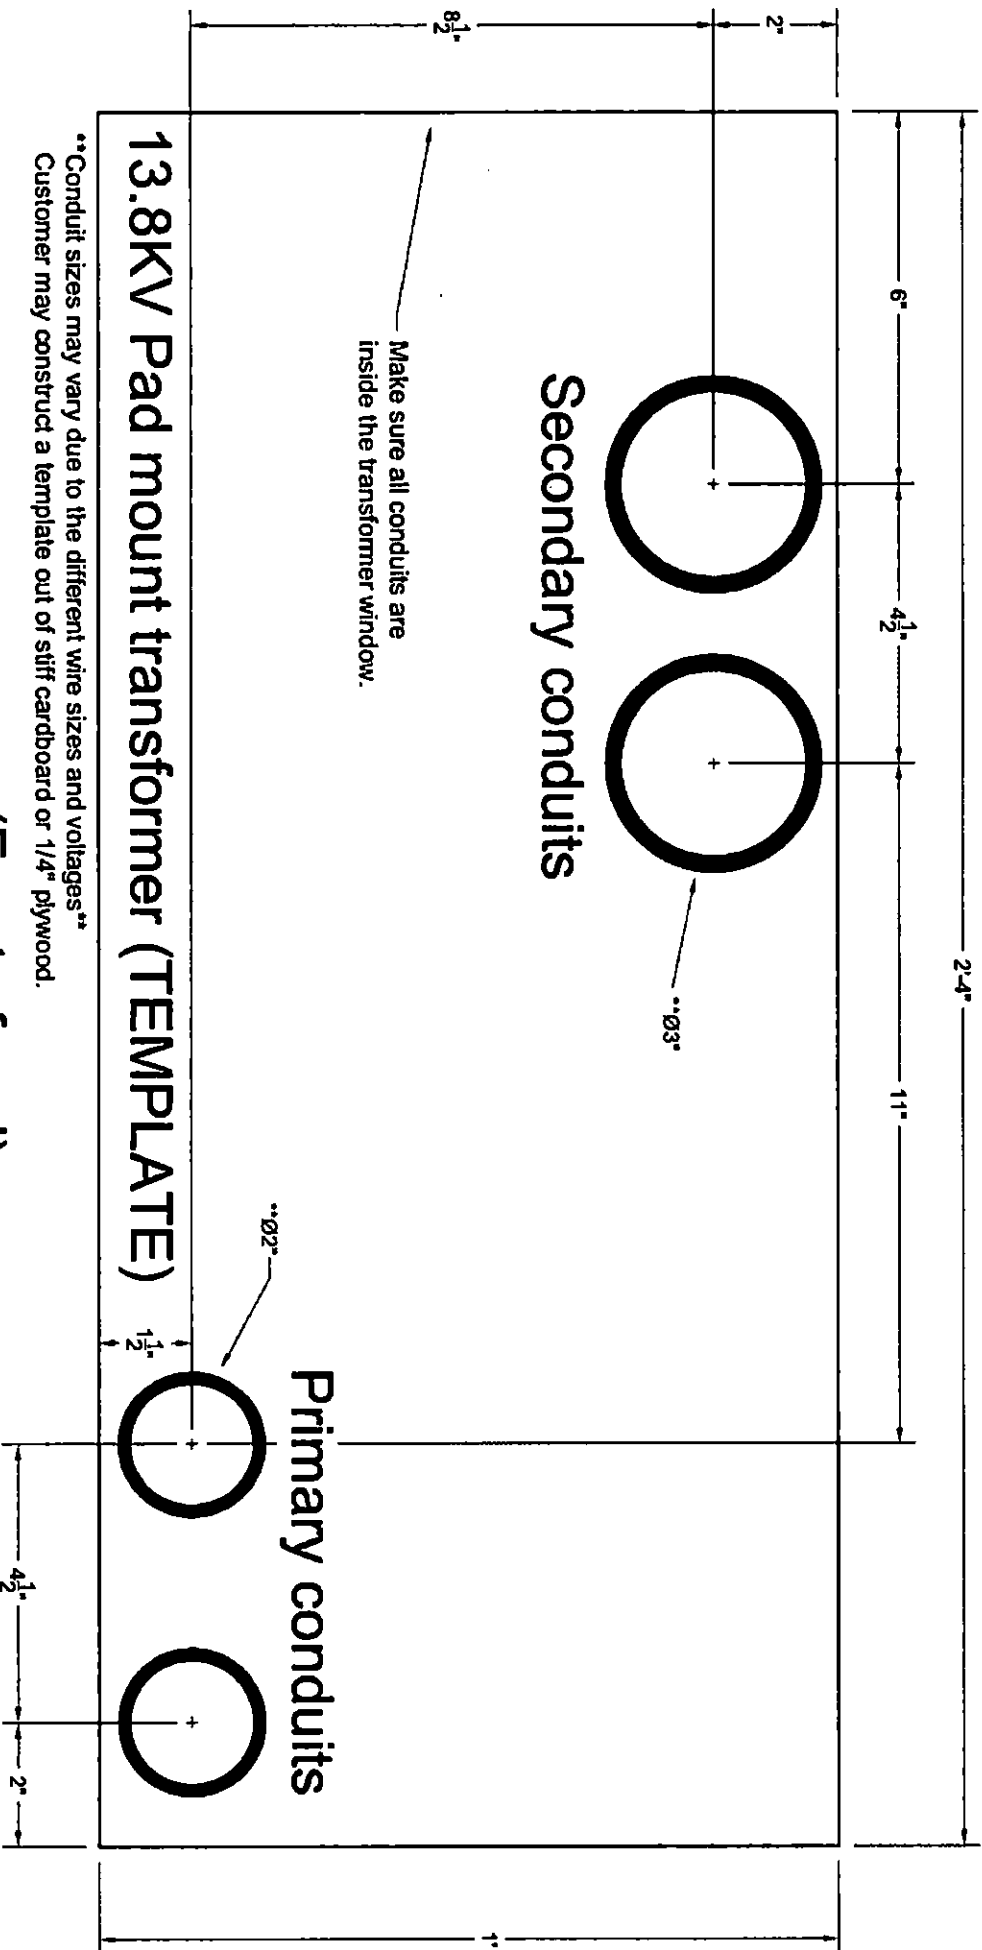

Secondary conduits

Make sure all conduits are inside the transformer window.


Primary conduits

**13.8KV Pad mount transformer (TEMPLATE)**

**(Front of pad)**

\*\*Conduit sizes may vary due to the different wire sizes and voltages\*\*  
 Customer may construct a template out of stiff cardboard or 1/4" plywood.

(This normally faces the street or driveway unless advised otherwise.)

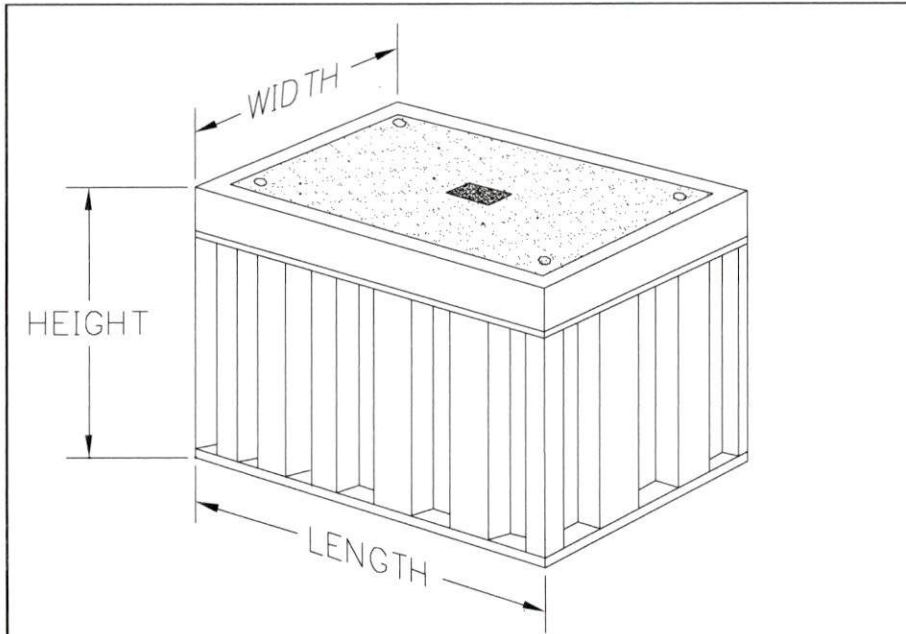

DISNAME	USC NUMBER	DESCRIPTION
PULLBOX-30x60	EN017578	PULL BOX, SINGLE PHASE, 30"W X 60"L X 48"H
PULLBOX-48x96	EN017580	PULL BOX, THREE PHASE, 48"W X 96"L X 48"H FOR USE WITH FEEDER CABLES ONLY.

**NOTES:**

1. ALL PULLBOXES ARE DESIGNED FOR A-16 LOADING (16,000 LBS. ON A 10" X 10" AREA)
2. ALL PULLBOXES ARE SUPPLIED WITH 2 PULLING EYES RATED AT 2000 LBS.
3. ALL PULLBOXES ARE SUPPLIED WITH TWO 30" LONG CABLE RACKS AND ADJUSTABLE 10" CABLE HOOKS
4. ALL PULLBOXES ARE SUPPLIED WITH A REMOVABLE BOTTOM.

ENTERGY SERVICES, INC.	
PULLBOXES	
APPROVED BY: JDS	DATE: 06-02-98
CHECKED BY: MCC	SCALE: N.T.S.
DRAWN BY: MCC	
No. UG1103011	
ENTERGY	PLOT 1=1 SH. 1 OF 1

NO.	DATE	REVISION	BY:	APPR:
-----	------	----------	-----	-------